


	mpressor model	Working pressure [bar(g)]	Com- pressed air con- nection	Air entrance aperture free cross section per unit [m²]	air volume	Air exhaust duct dimen- sions (free cross section) per unit [m²]	loss for exhaust	Compressed air collective line (two units)		Refrigera- tion dryer model	Com- pressed air con- nection	Air entrance aperture (free cross section) per unit [m²]	Incoming air volume per unit [m³/h]	Exhaust air fan (thermostatically controlled) per dryer [m³/h]	Filter Extra	Com- pressed air con- nection	ECO- DRAIN a)	Filter Adsorption	Com- pressed air con- nection	Air receiver	Com- pressed air con- nection	Control	Air main charging system	Com- pressed air con- nection	Condensate treatment unit AQUAMAT a)
Е	BSD 65	8.5	G 1 1/2	0.8	6840	0.49	60	DN 65	32	TD 76	G 2	0.3	3480	3480	F 83 KE	G 1 1/2	31 F	F 83 KA	G 1 1/2	3000	G 2½	SAM 4.0	DHS 65 G	G 2 1/2	CF 19
Е	BSD 75	8.5	G 1 1/2	1	8420	0.49	60	DN 65	32	TE 102	G 2	0.4	3040	3040	F 83 KE	G 2	31 F	F 83 KA	G 2	3000	G 2½	SAM 4.0	DHS 65 G	G 2 1/2	CF 38
Б	BSD 83	8.5	G 1 1/2	1.2	8490	0.49	60	DN 65	32	TF 142	G 2	0.4	3040	3040	F 83 KF	G 2	31 F	F 83 KA	G 2	3000	G 2½	SAM 4.0	DHS 65 G	G 2 1/2	CF 38

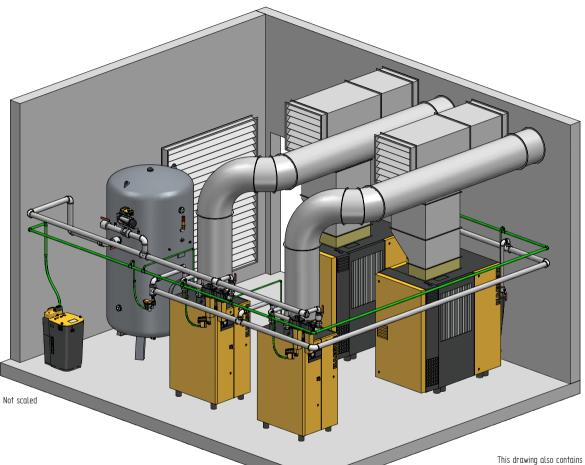

Design limits for ambient temperature + 40° [

a) Climatic zone 2

Air receiver represents minimum recommended size

This drawing also contains work to be done on site. The regulations of EN 1012 and national regulations for setting up of power installations like VDE 0100 have to be observed; the requirements of existing operational safety ordinance and the manuals have to be considered by the operator and the employer respectively at the place of installation.

The national safety and accident prevention regulations have to be observed.

The installation of a sub- assembly in terms of the pressure equipment directive 2014/68/EU has to be carried out according to this directive.

K	A	₹S	且	R
KO	MP	RESS	SOR	EN
Tampleto Day	47.07.2042			

	e)
Inst.	•

Date 26/09/2016 Nahhas1 Checked 26/09/2016 Hobusch

Description Sample layout sketch // 40° C 2x BSD with exhaust air duct

LYMU0007301e 2 of 2 (Shown 2x BSD 83, 2x TE 142, 2x F 83 KE, 2x F 83 KA) | Page

Condensate lines have to be connected to a collecting line via swan neck or are to be fed to the condensate treatment system separately. A pressure-less drain has to be provided for.

EMINENT POWER ENGINEERING PVT LTD Regd. Office: 871/B1/D, GIDC Industrial Estate,

Near Himalaya Char Rasta, Makarpura, Vadodara-390 010. Ph: +91 9824459599, Email: info@eminentpowerepl.com,

Website: www.eminentpowerepl.com

Minimum width of door is total component width + 100 mm