

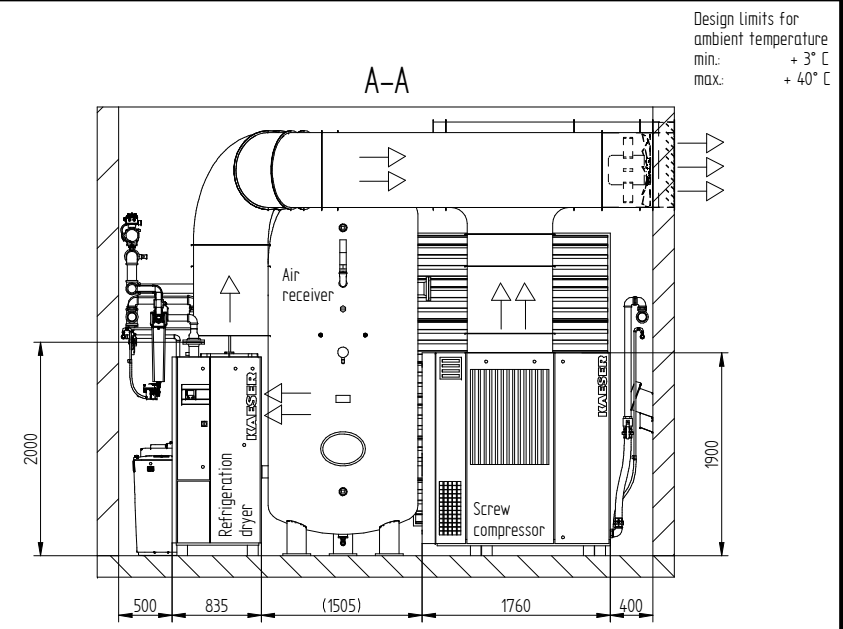
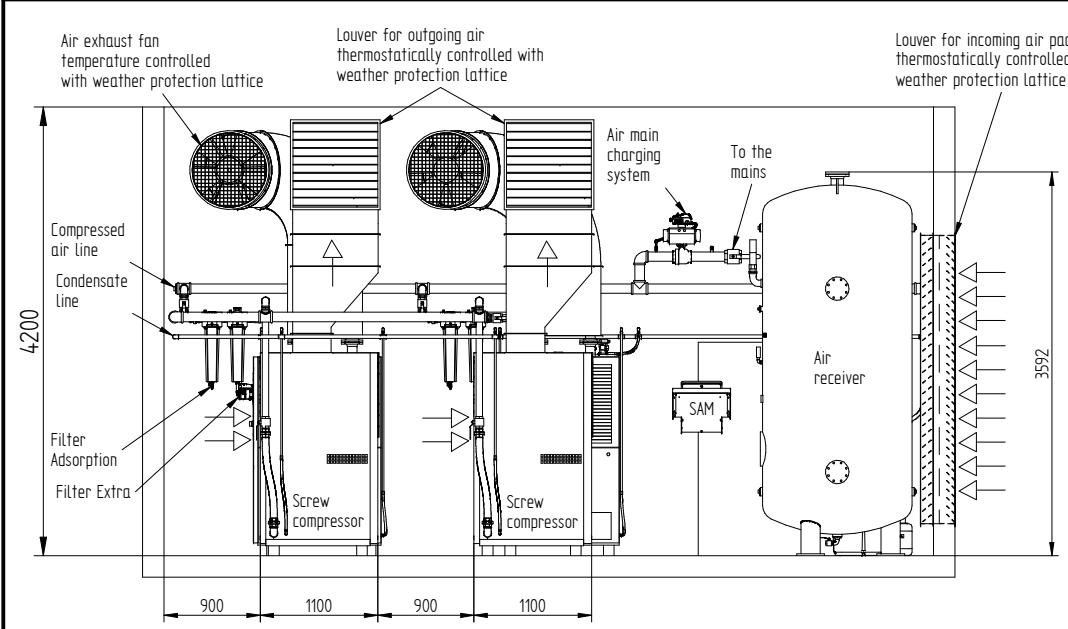


Drawings remain our exclusive property. They are intended only for the agreed purpose. Copies or any other reproduction, including storage, treatment and dissemination by use of electronic systems must not be made for any other than the agreed purpose. Neither originals nor reproductions may be given to or made available to third parties.

Die Zeichnung bleibt unser ausschließliches Eigentum. Sie wird nur zu dem vereinbarten Zweck anvertraut und darf zu keinem anderen Zweck verwendet werden. Kopien oder sonstige Vervielfältigungen einschließlich Speicherung, Verarbeitung oder Verbreitung unter Verwendung elektronischer Systeme dürfen nur zu dem vereinbarten Zweck angefertigt werden. Weder Original noch Vervielfältigungen dürfen Dritten ausleihend oder in sonstiger Weise zugänglich gemacht werden.

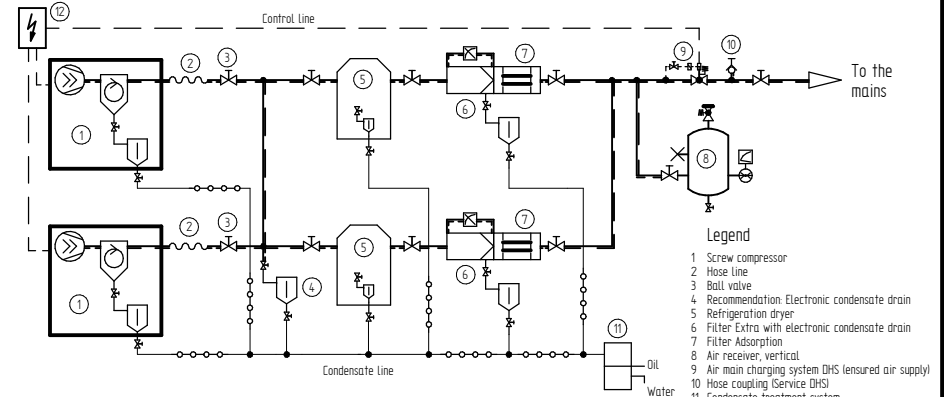

Design limits for ambient temperature  
min.: + 3° C  
max.: + 40° C

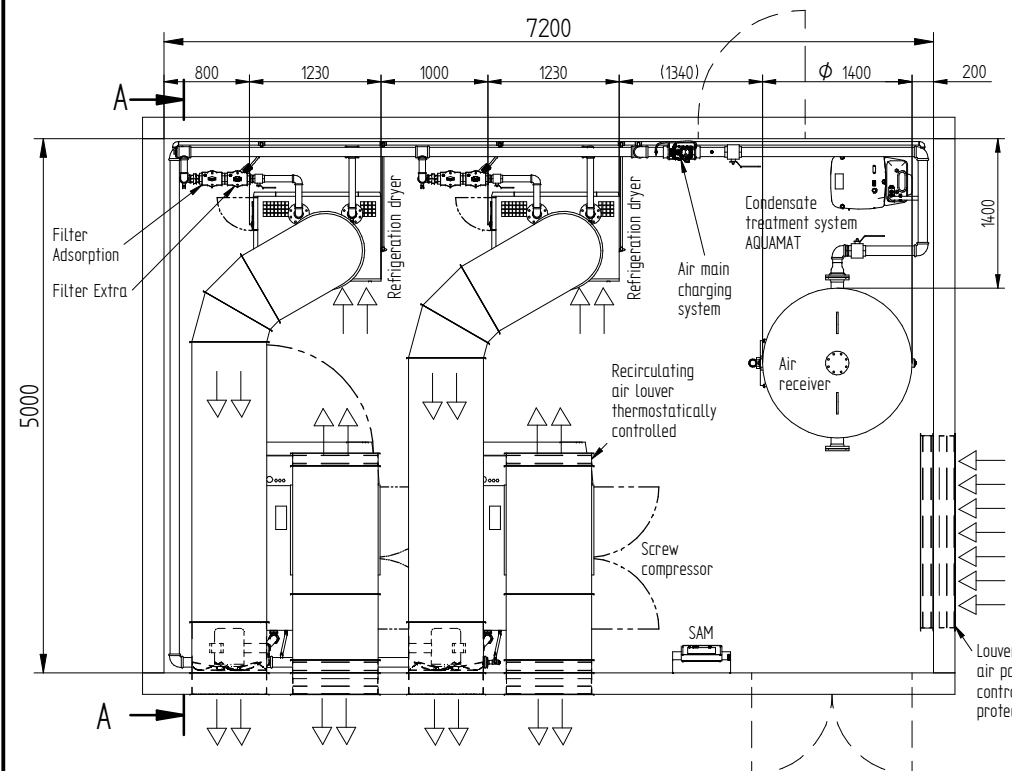

Condensate lines have to be connected to a collecting line via swan neck or are to be fed to the condensate treatment system separately. A pressure-less drain has to be provided for.

This drawing also contains work to be done on site. The regulations of EN 1012 and national regulations for setting up of power installations like VDE 0100 have to be observed; the requirements of existing operational safety ordinance and the manuals have to be considered by the operator and the employer respectively at the place of installation. The national safety and accident prevention regulations have to be observed. The installation of a sub- assembly in terms of the pressure equipment directive 2014/ 68/ EU has to be carried out according to this directive.

ATTENTION!  
Minimum width of door is total component width + 100 mm

Technical data see page 2

<b>KAESER</b> KOMPRESSOREN	P + I	Scale	Date	Name
	<input checked="" type="checkbox"/> Inst.	1:50	19/09/2016	Nahhas1
Template Rev. 17.07.2015	<input checked="" type="checkbox"/>	DIN A3	Checked	19/09/2016
Description	Sample layout sketch // 40° C		Plan No.	
2x CSD with exhaust air duct		LYMU0007201e		
IShown 2x CSD 125, 2x TF 230, 2x F 142 KE,KA)		Page 1 of 2		

We reserve the right to make changes in the course of development. This drawing can only be modified with CAD


Drawings remain our exclusive property. They are intended only for the agreed purpose. Copies or any other reproduction, including storage, treatment and dissemination by use of electronic systems must not be made for any other than the agreed purpose. Neither originals nor reproductions may be given to or made available to third parties.

Die Zeichnung bleibt unser ausschließliches Eigentum. Sie wird nur zu dem vereinbarten Zweck anvertraut und darf zu keinem anderen Zweck verwendet werden. Kopien oder sonstige Vervielfältigungen einschließlich Speicherung, Verarbeitung oder Verteilung unter Verwendung elektronischer Systeme dürfen nur zu dem vereinbarten Zweck angefertigt werden. Weder Original, noch Vervielfältigungen dürfen für andere als die vereinbarte Verwendung ausgestellt werden. Weder Originale noch Reproduktionen dürfen an Dritte oder Dritten zur Verfügung gestellt werden.

Compressor model	Working pressure [bar(g)]	Compressed air connection	Air entrance aperture free cross section per unit [m²]	Incoming air volume per unit [m³/h]	Air exhaust duct dimensions (free cross section) per unit [m²]	Permissible overall pressure loss for exhaust duct per unit Δp [Pa]	Compressed air collective line (two units)	Water trap ECO-DRAIN a)	Refrigeration dryer model	Compressed air connection	Air entrance aperture (free cross section) per unit [m²]	Incoming air volume per unit [m³/h]	Exhaust air fan (thermostatically controlled) per dryer [m³/h]	Filter Extra	Compressed air connection	ECO-DRAIN a)	Filter Adsorption	Compressed air connection	Air receiver [l]	Compressed air connection	Control	Air main charging system	Compressed air connection	Condensate treatment unit AQUAMAT a)
CSD 85	8.5	G 2	1.2	9890	0.64	80	DN 80	32	TE 142	G 2	0.4	3040	3040	F 83 KE	G 2	31 F	F 83 KA	G 2	3000	G 2 1/2	SAM 4.0	DHS 80	DN 80	CF 38
CSD 105	8.5	G 2	1.4	10010	0.64	80	DN 80	32	TF 174	DN 65	0.8	7800	7800	F 110 KE	G 2	31 F	F 110 KA	G 2	5000	DN 100	SAM 4.0	DHS 80	DN 80	CF 38
CSD 125	8.5	G 2	1.8	11420	0.64	60	DN 80	32	TF 230	DN 80	0.8	7800	7800	F 142 KE	G 2	31 F	F 142 KA	G 2	5000	DN 100	SAM 4.0	DHS 80	DN 80	CF 75

Design limits for ambient temperature  
min: + 3° C  
max: + 40° C

a) Climatic zone 2

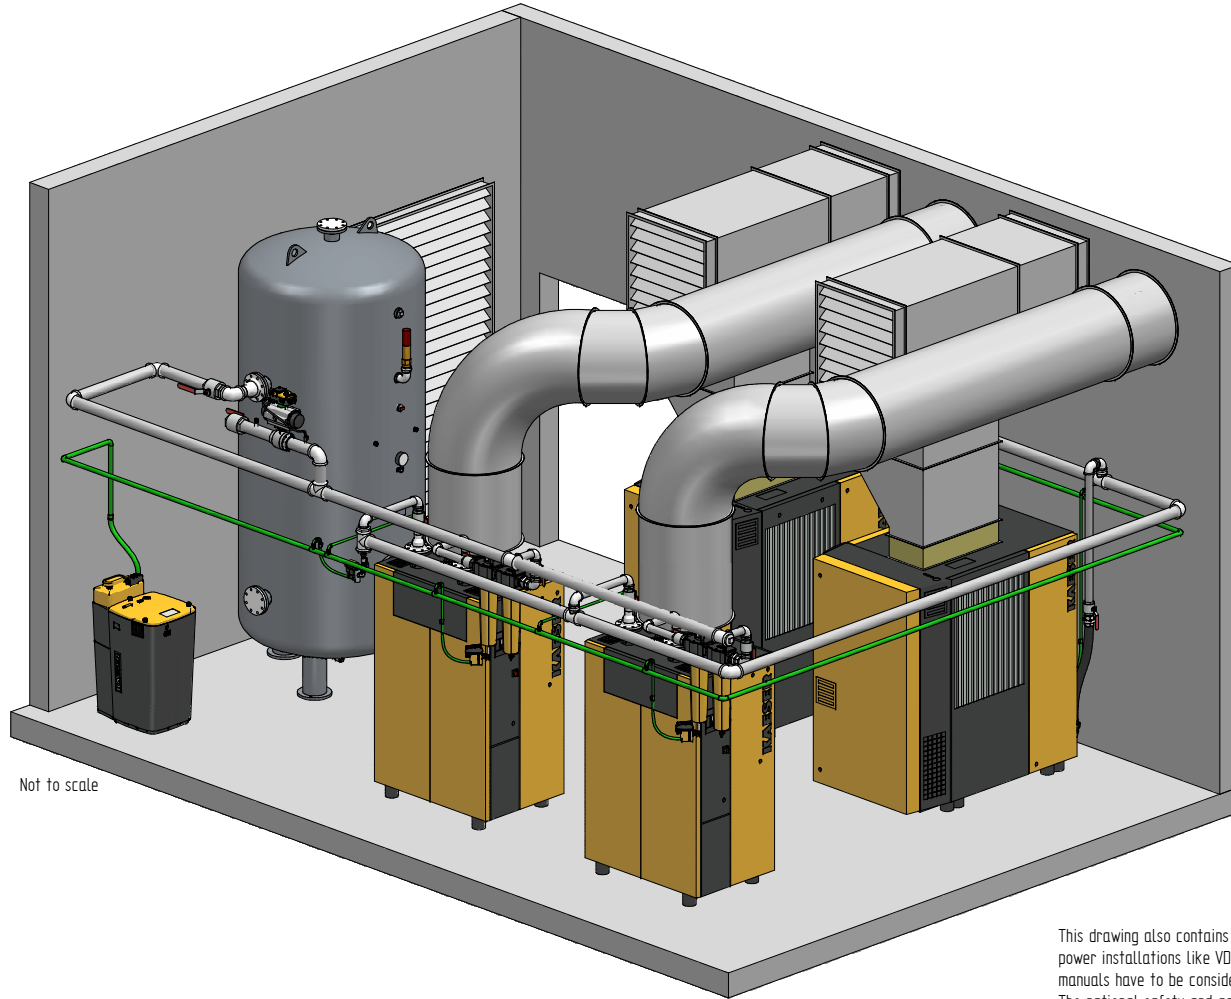

Not to scale

Air receiver represents minimum recommended size.

This drawing also contains work to be done on site. The regulations of EN 1012 and national regulations for setting up of power installations like VDE 0100 have to be observed; the requirements of existing operational safety ordinance and the manuals have to be considered by the operator and the employer respectively at the place of installation. The national safety and accident prevention regulations have to be observed. The installation of a sub-assembly in terms of the pressure equipment directive 2014/ 68/ EU has to be carried out according to this directive.

**EMINENT POWER ENGINEERING PVT LTD**  
 Regd. Office : 871/B1/D, GIDC Industrial Estate,  
 Near Himalaya Char Rasta, Makarpura, Vadodara-390 010.  
 Ph : +91 9824459599, Email : info@eminentpowerepl.com,  
 Website : www.eminentpowerepl.com

ATTENTION!  
 Minimum width of door is total component width + 100 mm

Condensate lines have to be connected to a collecting line via swan neck or are to be fed to the condensate treatment system separately. A pressure-less drain has to be provided for.

<b>KAESER</b> KOMPRESSOREN	P + I <input checked="" type="checkbox"/>	Scale 1:50 DIN A3	Date	Name
	Inst. <input checked="" type="checkbox"/>		Drawn 19/09/2016 Nahhas1	Checked 19/09/2016 Hobusch
Description Sample layout sketch // 40° C 2x CSD with exhaust air duct IShown 2x CSD 125, 2x TF 230, 2x F 142 KE,KA			Plan No. LYMU0007201e	
			Page 2 of 2	

We reserve the right to make changes in the course of development. This drawing can only be modified with CAD